



SEE ENLARGED DETAILS
E 7.18

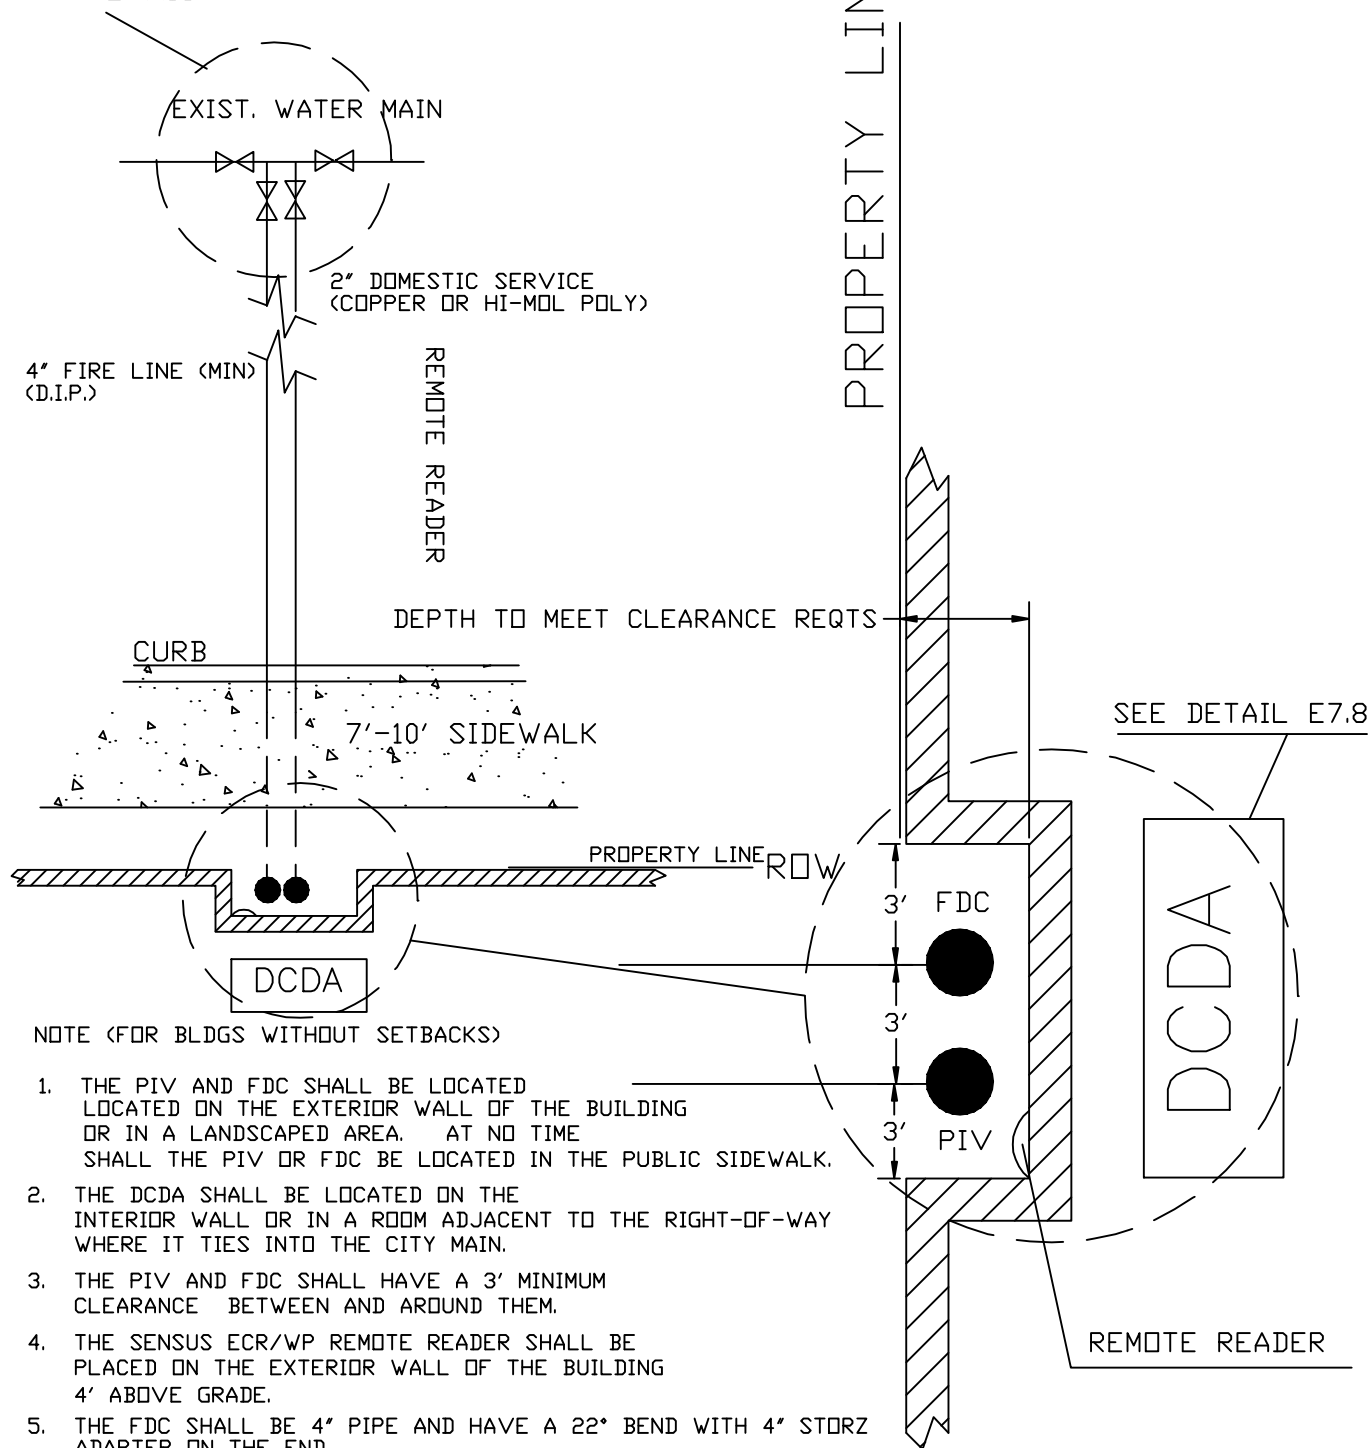

NOTE (FOR BLDGS WITHOUT SETBACKS)

1. THE PIV AND FDC SHALL BE LOCATED ON THE EXTERIOR WALL OF THE BUILDING OR IN A LANDSCAPED AREA. AT NO TIME SHALL THE PIV OR FDC BE LOCATED IN THE PUBLIC SIDEWALK.
2. THE DCDA SHALL BE LOCATED ON THE INTERIOR WALL OR IN A ROOM ADJACENT TO THE RIGHT-OF-WAY WHERE IT TIES INTO THE CITY MAIN.
3. THE PIV AND FDC SHALL HAVE A 3' MINIMUM CLEARANCE BETWEEN AND AROUND THEM.
4. THE SENSUS ECR/WP REMOTE READER SHALL BE PLACED ON THE EXTERIOR WALL OF THE BUILDING 4' ABOVE GRADE.
5. THE FDC SHALL BE 4" PIPE AND HAVE A 22° BEND WITH 4" STORZ ADAPTER ON THE END.
6. THE WATER METER SHALL BE LOCATED AT THE PROPERTY LINE WHENEVER POSSIBLE. LOCATION OTHER THAN THE PROPERTY LINE, SHALL BE DETERMINED BY THE CITY INSPECTOR.



CITY OF EDMONDS

REVISIONS

APPROVED BY	DATE
D. GEBERT	07/12/05
D. GEBERT	4/2/07

STANDARD DETAIL

FIRE LINE AND 2" DOMESTIC SERVICE CONNECTIONS (PLAN VIEW) ZERO-SETBACK BUSINESS/ COMMERCIAL ZONE

DATE	03/24/05	SCALE	NTS	DWG NO.	E7.19
------	----------	-------	-----	---------	-------